
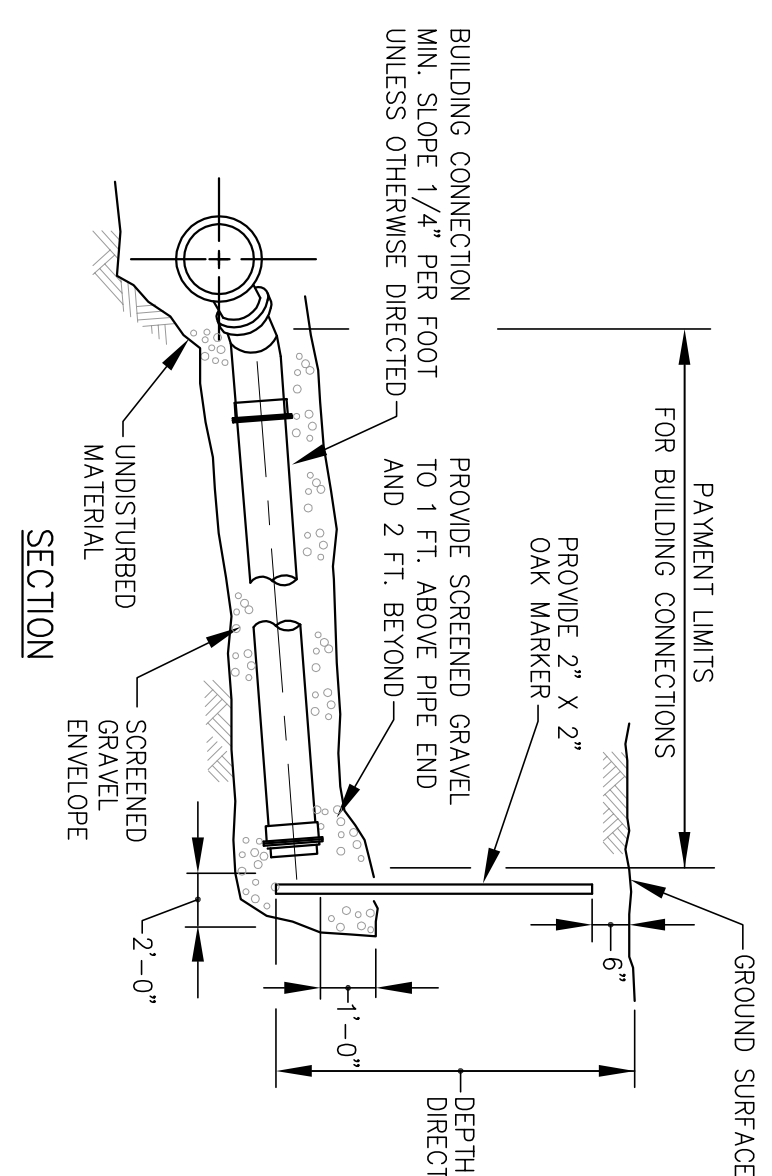



4'-0" PRECAST REINFORCED CONCRETE
MANHOLE BASE FOR PVC SEWERS AND DRAINS

NOT TO SCALE
2-1.5.14 (REV. 03-15-95)

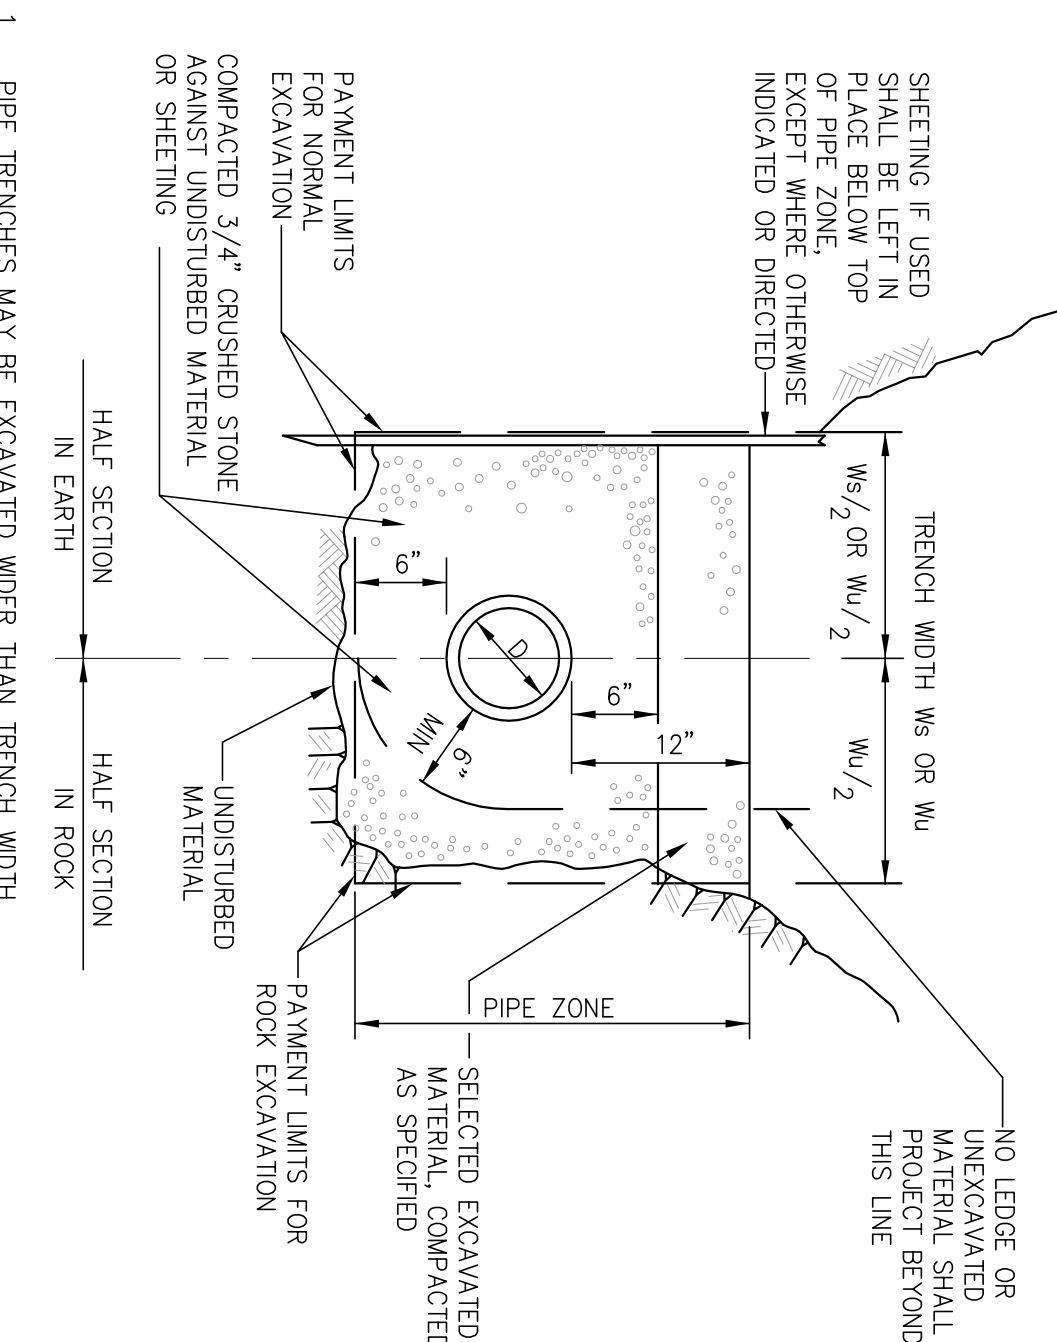

TRENCH WIDTH W_s OR W_u		
NOMINAL PIPE DIAMETER D	DEPTH OF PIPE INVERT BELOW GROUND SURFACE	
	0 TO 12"	12" TO 20"
24" AND SMALLER	5'-0"	7'-0"
OVER 24"	D + 3'-0"	D + 5'-0"

TRENCH SECTION IN UNSUITABLE MATERIAL	
NOT TO SCALE 2-1/2" (REV. 03-15-95)	
DATE	REVISION

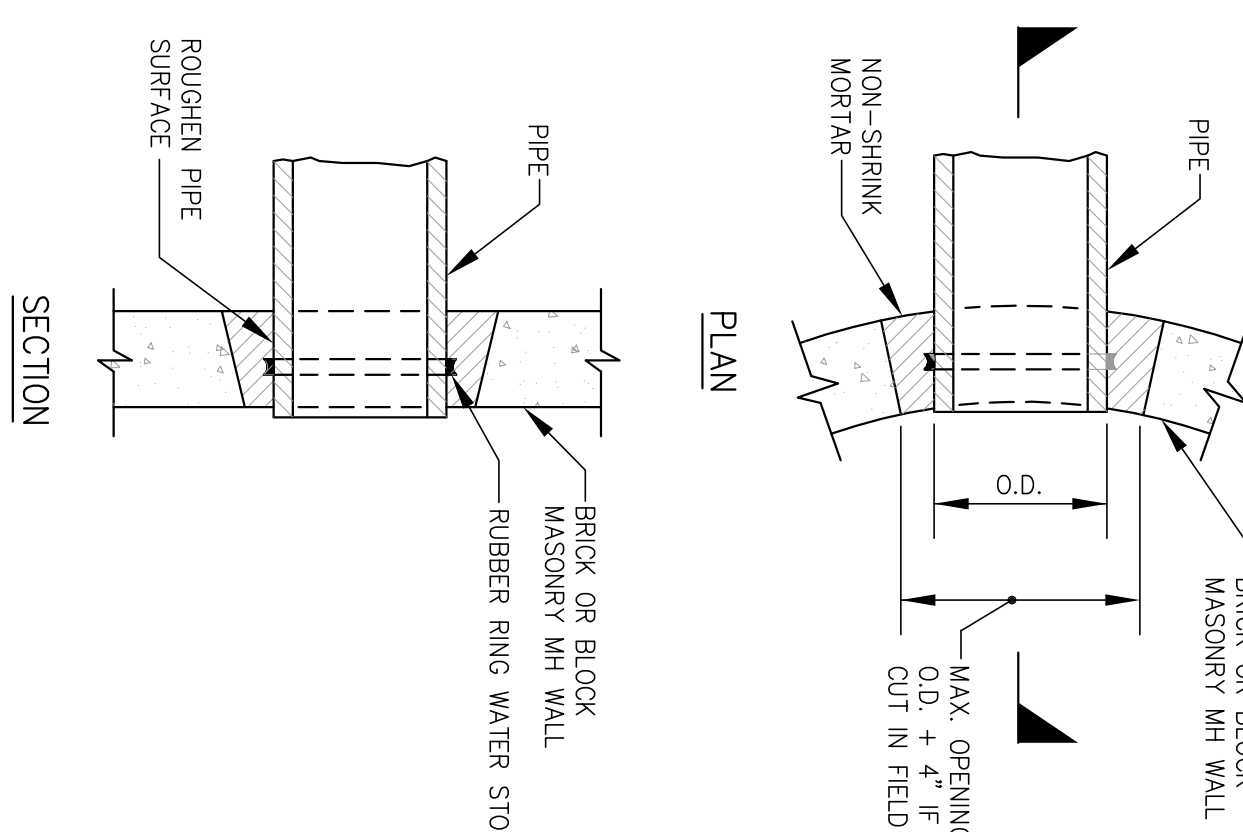

NON-SHRINK MORTAR JOINTS
FOR CONNECTING PIPES TO
BRICK OR BLOCK MASONRY MANHOLES

TOWN OF LEXINGTON		
DATE	REVISION	BY

STANDARD DETAILS	JOINT OF DETAILING


SEWER II
DIAMOND DRIALLO

[illegible]

TOWN OF LEXINGTON		SCALE: AS NOTED
DRAWN BY: C.O.	DATE: APRIL 2012	
DESIGNED BY: DC	CHECKED BY:	

APPROVED BY: _____

ENGINEERING



DIVISION _____ *ANNUAL REPORT* _____